


SIDE SEWER IN PRIVATE PROPERTY

NTS

SITE CONSTRUCTION NOTES –TYPICAL FOR MOST SIDE SEWER CONNECTIONS

- A. CONNECTION MADE TO BUILDING SEWER PLUMBING WITH STAINLESS STEEL SHEILDED BAND BY; MISSION (ARC), STRONGBACK, INDIANA SEAL (GPK) OR APPROVED EQUAL.
- B. SEWER PLUMBING TO EXTEND 30-INCH MINIMUM DISTANCE FROM HOUSE/BLDG.
- C. 18-INCH MINIMUM COVER INSIDE PROPERTY LINE
- D. WYE, WITH CAP.
- E. CLEANOUT, SEE STD. PLAN 15 OR 15A.
- F. 45° FITTING

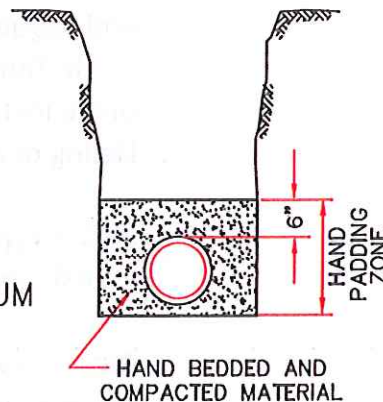

VALLEY VIEW SEWER DISTRICT DETAIL 0

**SIDE SEWER REQUIREMENTS**

NOT TO SCALE

## GENERAL REQUIREMENTS

1. A side Sewer Permit is required prior to work being started.
2. A Tax Lot Number and/or a Legal Description of the lot must be provided.
3. All work done in the public Right of Way must be done by a District approved contractor under an approved Right of Way permit.
4. Bedding of pipe must be done by hand. No backfilling will be done until inspection is completed and approved.
5. Bedding and initial backfill material must be free from large rocks.

## SIDE SEWER REQUIREMENTS

1. 4-inch and 6-inch (minimum size) sewer pipe required on property, 2% minimum grade ( $\frac{1}{4}$  inch fall per foot).
2. Joint side sewers require 6 inch pipe for common use and require an easement agreement. No more than 4 single family residences are allowed to connect into one 6 inch sewer stub.
3. Listing of approved pipe:

**PVC** = Type SDR-35 ASTM-3034 (with standard gasket joints) Schedule 40 PVC ASTM-D1785.

**ABS** = Type DWV Schedule 40 ASTM-D2661 (with solvent weld or glue joints).

**NOTE:** Solvent weld joints are only permitted in conjunction with ABS type pipe and PVC Schedule 40 pipe.